





## Series SAH SMART Air Hood® Balancing Instrument

### Specifications - Installation and Operating Instructions

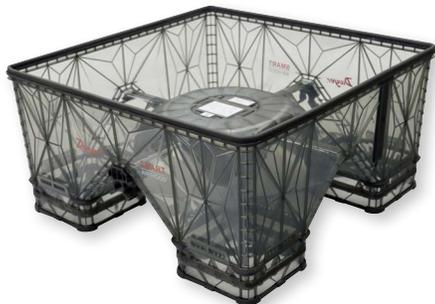

Optional handheld device UHH7 shown

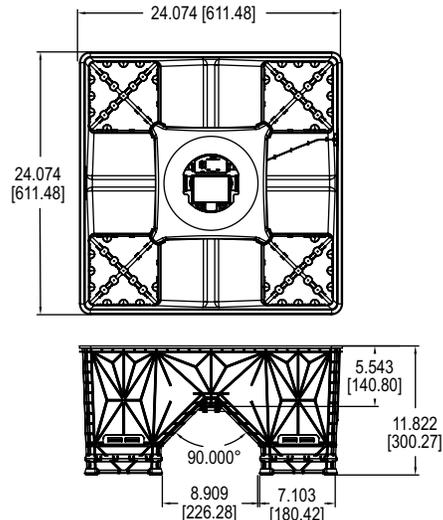

The **SMART AIR HOOD® (SAH) Balancing Instrument** is the most accurate and easy to operate air flow hood on the market today. The low profile design allows balancers to work in occupied spaces (bathroom stalls, MRI machines, cubicles, tables/chairs, etc.) and maneuver through doorways easier. By using the included 12 foot hood pole and wireless communications to a mobile device, one operator can balance a branch in less time than traditional balancing teams. Besides being lighter than most traditional capture hoods, the ergonomic design makes the technician exude less energy as the SAH has a lighter, balanced design. The rugged polypropylene base hood features Quad Flow Design Technology for controlling air flow and minimizing back pressure, which yields superior measurement accuracy. The Wi-Fi protocol back to the user's Android® or iOS® device gives the user real-time feedback, as they may be up to 200 yards (183 m) from the hood which saves the technician from unnecessarily going up and down their ladder multiple times to cut or open the dampers to balance the system.

The **SMART AIR HOOD® Application Software** reduces the number of steps in the air flow balancing process using Predictive Balancing. Predictive Balancing is a method of predicting the optimal flow set point for each register and the order in which they should be adjusted.

#### INCLUDED WITH THE SAH KITS:

- 3 ft (0.9 m) extendable pole
- 12 ft (3.7 m) extendable pole
- Mobile device quick release pole adaptor kit
- Two low flow plugs
- Softcase SAH22 or hardcase SAH-22HC with storage for additional instruments
- Lithium ion battery (not included in international versions)
- Installation and operating manual
- NIST traceable certificate
- Charging cables for SAH

#### SPECIFICATIONS

**Service:** Air.

**Units:** Cubic feet per minute (CFM), cubic meter per hour (M<sup>3</sup>/H), cubic meter per second (M<sup>3</sup>/S), liter per minute (l/min), liter per hour (l/hour), liter per second (l/s).

**Volume Flow Ranges:** Supply: 40 to 2000 CFM (68 to 3398 m<sup>3</sup>/h) (19 to 944 l/s); Exhaust: 80 to 2000 CFM (136 to 3398 m<sup>3</sup>/h) (38 to 944 l/s).

**Accuracy > 40 CFM:** ±3% of reading ±7 CFM (11.9 m<sup>3</sup>/hr) (3.3 l/s).

**Resolution:** 1 CFM (1.7 m<sup>3</sup>/h) (.5 l/s).

**Power Requirements:** 3.6 V NCR18650B MH12210 Li-ion rechargeable battery (included), or (4) AA alkaline 1.5 V batteries (not included).

**Housing Material:** Polypropylene.

**Weight of Hood:** 5.75 lb (2.6 kg).

**Supported Devices:** UHH6 and newer, and smart devices with Android® firmware version 8.0 and above or iOS® version 14.1 and above.


**Software:** SMART Air Hood® application software, available on the Google Play™ store and the App Store®.

**Wireless Protocol:** Wi-Fi wireless technology.

**Response Time:** 1 s.

**Compliance:** CE, FCC, IC, RCM (-AU model only).

**FEATURE OUTLINES**  
SAH Hood

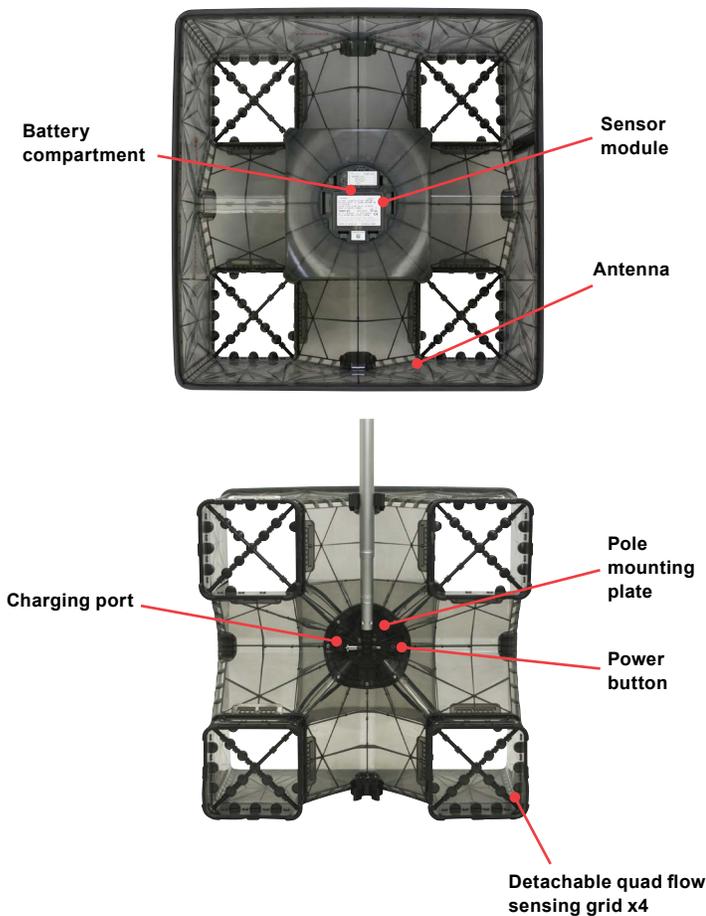

**INTRODUCTION**

**WARNING** Do not use the hood unit for liquid or gas mixtures other than air. No responsibility will be taken by Dwyer Instruments, LLC for any resulting damage to the unit or to the operator if it is used with corrosive or dangerous or explosive gas mixtures. When using the hood to check air flow at ceiling diffusers, make certain that you can raise and hold the unit safely during use. This instrument is not classified as flameproof or intrinsically safe; therefore, it must not be used where an explosion hazard may exist. The unit is not authorized for use on life support applications.

**Note:** Observe standard safety procedures when working on ladders and scaffolding. Also, ensure the unit does not become caught in moving machinery or on sharp objects.

- CAUTION**
- If stored under conditions outside normal operating range, allow the unit to stabilize at room conditions before use.
  - Owing to its size and shape, take care when carrying the assembled unit from place to place.
  - Avoid people and nearby equipment.
  - Avoid objects that may damage the capture hood.
  - Turn the instrument off before storage or transportation and remove the batteries if storing for long periods of time.
  - Avoid subjecting the quad flow sensing grids to excessive loading during use or assembly. Any air flow other than through the calibrated sensing holes, such as any hair-line cracks, will seriously affect the sensitivity. A damaged quad flow sensing grid must be replaced. It cannot be repaired.
  - Do not disassemble the quad flow sensing grids from the capture hood while taking readings or balancing. The retaining structure is specifically designed to accommodate loading due to normal operation.
  - Under low humidity conditions, static electric charges may be encountered. These can be avoided by applying a suitable anti-static solution.

**SETUP**  
**Battery Requirements**

**SAH Battery**

**WARNING** **Fire Hazard While Charging Battery**  
Match the lithium-ion battery polarity symbols on the battery to the polarity symbols inside the battery bracket. **Failure to do so may result in personal injury or property damage.** The orientation of the polarity symbols on the battery must match the orientation of the label inside the SAH battery bracket (+ to +, - to -). The positive terminal of the NCR18650B battery is also marked by a wide black band on the battery.


If a SAH-22-IN (less battery) was purchased, a 3.6 V NCR18650B lithium ion battery, or the equivalent, needs to be purchased from a local supplier and installed properly before the SMART Air Hood® Balancing Instrument can be operational.

Before beginning use with the SAH, it is suggested that the unit be charged using the included charging cable. Plug the mini-USB end of the cable into the unit's charging port and the USB end into the charging block.

**Battery Backup**

Four AA batteries can be used as a backup for the lithium ion rechargeable battery, in case it loses charge during a job.

**WARNING** Be sure to install batteries correctly.

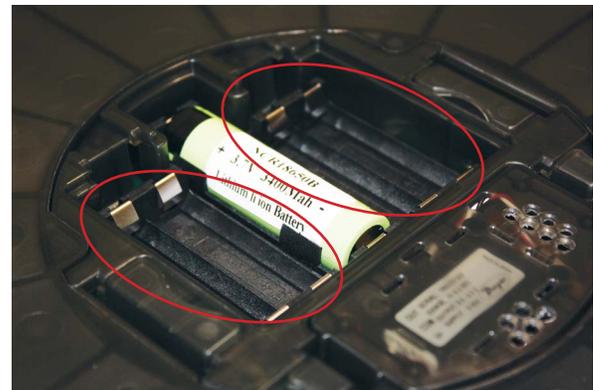


**Lithium Battery Status**

The LED lights on the hood change color and pattern depending on the status of the battery.

LED Location	LED Color/Pattern	Lithium Battery Status
Hood & Power Button	Red (blink)	Battery is critically low
Hood & Power Button	Red (on)	Battery is low
Power Button	Red (on)	Battery is charging
Power Button	Green (on)	Battery is fully charged

**Powering the Unit**

The SMART Air Hood® balancing instrument is ready to use directly out of the box. No assembly process is required. The unit can be powered on by pushing the power button, it should turn green when turned on.

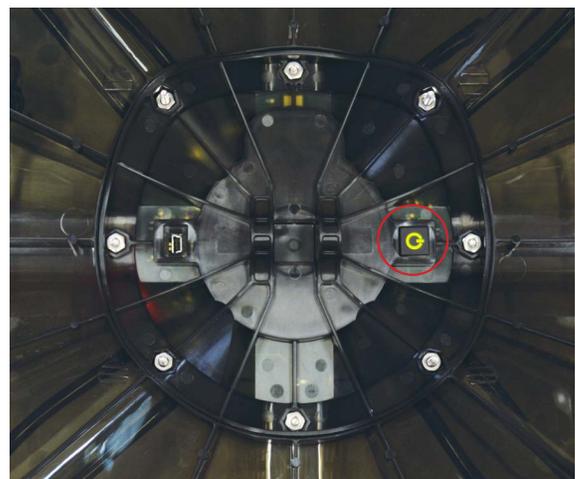

To turn off the hood, press and hold the power button until the LEDs turn off.

**INSTALLATION**

**Assembling Accessories**

In order to place the hood onto a diffuser to measure air flow it needs to be mounted to one of the two provided poles.

To connect the pole to the hood, align the hole at the end of the pole with the holes in the mounting plate of the hood. Insert the provided locking pin through the holes in order to lock the pole to the hood. When inserting the locking pin, start by placing it into the alignment hole on the opposite side from the power button as illustrated below. In order to insert or remove the pin, press in the button on the end of the pin.



When using the short pole or with the SAH adapter base kit for canvas hoods, the stationary pole adapter should be used to keep the hood pole from pivoting. Place the stationary pole adapter onto the SAH and attach using the screws and wing nuts provided (below). Once secure to the SAH, insert the short pole and secure in place using the locking pin.



To attach a mobile device to the pole, attach the locking attachment to the mobile device case as shown below. Secure the mobile device to the pole using locking attachment by inserting it into the locking device on the pole and rotating 1/4 turn.



Once the mobile device is attached to the pole, the SMART Air Hood® balancing instrument is now ready for use.

For shorter ceilings it is recommended to leave the top section of the pole inserted into the pole and adjust the height with the middle section for greater stability.

**OPERATION**

**Connecting the SMART Air Hood® Balancing Instrument to the Smart Air Hood® Application Software**

The LED lights on the hood blink in certain patterns depending on its communication with the mobile device.

Blue LED State	Red LED State	Connection Status
50% duty cycle	50% duty cycle	Not connected
20% duty cycle	20% duty cycle	Attempting to connect
5% duty cycle	5% duty cycle	Connected

**Placing the SMART Air Hood® Balancing Instrument on a Diffuser**

Place the hood on the diffuser and ensure that there are no leaks by visually inspecting that the hood seal completely surrounds the diffuser. Make sure to check every side and corner of the hood and verify that it is sealed onto the diffuser.



Once the hood is placed correctly, twist the pole to adjust the pole length so that it reaches the floor supporting the hood itself. If the hood is not securely in place, then re-adjust the pole length until it is free standing.

**FCC/INDUSTRY CANADA NOTICE**

**NOTICE** This device complies with Part 15 of the FCC rules. Operation is subject to the following two conditions:  
 (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between equipment and receiver.
- Connect the equipment to an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

**NOTICE** This device complies with Industry Canada license-exempt RSS standard(s). Operation is subject to the following two conditions:  
 1. This device may not cause harmful interference;  
 2. This device must accept any interference received, including interference that may cause undesired operation of the device.

**CAUTION** Pursuant to FCC 15.21 of the FCC rules, changes or modifications not expressly approved by Dwyer Instruments, LLC may void the user's authority to operate the equipment.

## RF NOTICE

### NOTICE

This product complies with FCC OED Bulletin 65 and Industry Canada's RSS-102 radiation exposure limits set forth for an uncontrolled environment.

### NOTICE

This Class B digital apparatus complies with Canadian ICES-003.

### CAUTION

The antenna used for this transmitter must maintain a separation of at least 20 cm from all persons and must not be co-located or operating in conjunction with any other antenna or transmitter.

### AVIS

Cet appareil est conforme à Industrie Canada une license standard RSS exonérés (s). Son fonctionnement est soumis aux deux conditions suivantes:

1. Cet appareil ne doit pas provoquer d'interférences,
2. Cet appareil doit accepter toute interférence reçue, y compris les interférences pouvant provoquer un fonctionnement indésirable de l'appareil.

### AVIS

Ce produit est conforme aux limites d'expositions aux rayonnements définies pour un environnement non contrôlé du Bulletin 65 FCC OET et RSS-102 Industry Canada.

## Wired Connection

The SAH can be connected directly to a mobile device using the provided USB adapter cables. While the SAH is connected to a mobile device via USB, the Wi-Fi in the SAH is disabled. This connection method is useful when a Wi-Fi connection is unreliable or when Wi-Fi is prohibited. The Wi-Fi in the SAH is re-enabled when the USB cable is disconnected.

## Airplane Mode

Airplane mode disables all wireless communication on a mobile device. Airplane mode is useful when operating in an environment that restricts the use of wireless communication. When Airplane Mode is enabled, the SAH can only be used with a wired connection.

## TROUBLESHOOTING

Reported Problem	Possible Solution
No or not changing data	<ul style="list-style-type: none"> <li>- Verify sensor module is plugged in</li> <li>- Check for leaks in diffuser sealing tubing</li> <li>- Verify SAH connection by looking at LED blinking pattern</li> <li>- Verify quad flow sensing grids are fully seated and not damaged</li> <li>- Verify the hood has a good seal with the diffuser/grille</li> <li>- Check for any blockage in the inlets and outlets of the hood</li> <li>- Check for cracks in the hood body</li> </ul>
Reading is too high or low	<ul style="list-style-type: none"> <li>- Verify quad flow sensing grids are fully seated and not damaged</li> <li>- Verify the hood has a good seal with the diffuser/grille</li> <li>- Check for any blockage in the inlets and outlets of the hood</li> <li>- Check for cracks in the hood body</li> <li>- Check for possible damage in the rubber seal</li> </ul>
Cannot connect to hood	<ul style="list-style-type: none"> <li>- Verify the connection is attempted within the proximity of the mobile device</li> <li>- Restart the SMART Air Hood® application software</li> <li>- Power cycle the hood and/or mobile device</li> <li>- Check the battery status of both the hood and mobile device</li> </ul>

## MAINTENANCE

Some simple routine maintenance after each use will ensure that the instrument will function correctly for many years.

- Remove any moisture droplets using a clean, absorbent lint-free cloth/paper towel before storing the unit.
- Remove all batteries if the unit is to be stored for an extended period of time.
- Always store and transport the unit carefully. Store in dry conditions.
- DO NOT immerse the hood in water. • DO NOT use abrasive cleaning products on the hood. The hood can be wiped clean with a damp lint-free cloth.
- DO NOT use abrasive cleaning products on the quad flow sensing grids, which may block or damage the grid. The grid may be CAREFULLY wiped clean with a lint-free cloth. Ensure the air entry holes of the quad flow sensing grids are not contaminated with moisture.
- Check periodically for damage or any visible cracks.
- Take care to not damage or obscure the air entry holes of the quad flow sensing grids. This can seriously affect the measurements obtained.

Diffuser adapter hood fabric can be wiped clean with a damp cloth, if necessary, and moisture droplets dried with an absorbent lint-free cloth/paper. Periodically, wash in cool water using a mild detergent. Drip dry, ensuring it cannot become caught in any sharp objects.

The fabric used is impermeable, tough, and very resistant under normal use. In the event that the fabric becomes worn or torn, replace the fabric hood immediately. A damaged hood will seriously affect the measurements taken.

Anti-static solution can be applied to the instrument by using a clean, lint-free cloth and carefully rubbing it over the instrument.

**Note:** This is normally only necessary when working in low humidity conditions.

## Annual Calibration

It is recommended to have the unit calibrated annually to ensure the accuracy of the unit. For calibration purposes, all four quad flow sensing grids and the sensor module must be sent to a Dwyer authorized service facility. Contact customer service for more information.

## REPAIR

The Series SAH SMART Air Hood® balancing instrument is not field serviceable and it is not possible to repair the unit. Field repair should not be attempted and may void warranty.

## WARRANTY/RETURN

Refer to "Terms and Conditions of Sale" in our catalog and on our website. Contact [returns@dwyermail.com](mailto:returns@dwyermail.com) to receive a Return Materials Authorization number before shipping the product back for repair. Be sure to include a brief description of the problem plus any additional application notes.

Android® is a registered trademark of Google LLC  
 App Store® is a trademark of Apple Inc.  
 Bluetooth® is a registered trademark of Bluetooth SIG, Inc.  
 Google Play™ is a trademark of Google LLC  
 iOS® is a registered trademark of Cisco Technology, Inc.